



Catalog Number: U5320-O-75GB  
Item Description: 125A MTR DBL DB PED  
UPC Code: 784572368767

**Brand Name:** Milbank

**Type:** Ring Type Metered Power Supply Unit

**Special Features:** 4 Terminal, Plain Top, 2 Barrel Ground Lug and Ground Bar, No Bypass, Double Power Head, 6 Branch Circuits

**Application:** RV Power

**Standard:** UL Listed

**Voltage Rating:** Up to 240 Volts Alternating Current

**Amperage Rating:** 125 Ampere Continuous

**Wattage:** Not Applicable

**Frequency Rating:** 60 Hertz

**Phase:** 1 Phase

**Number of Receptacles:** 3

**Receptacle Configuration:** NEMA 14-50, NEMA TT30, NEMA 5-20


**Control:** One Single Pole 20 Ampere Ground Fault Breaker, One Single Pole 30 Ampere Breaker, One Double Pole 50 Ampere Breaker, No Main Breaker

**Material:** G90 Galvanized Steel with Powder Coat Finish




**Mounting:** Pedestal Mount

**Cable Size:** 6 AWG to 350 KCMIL


**Enclosure:** Type 3R

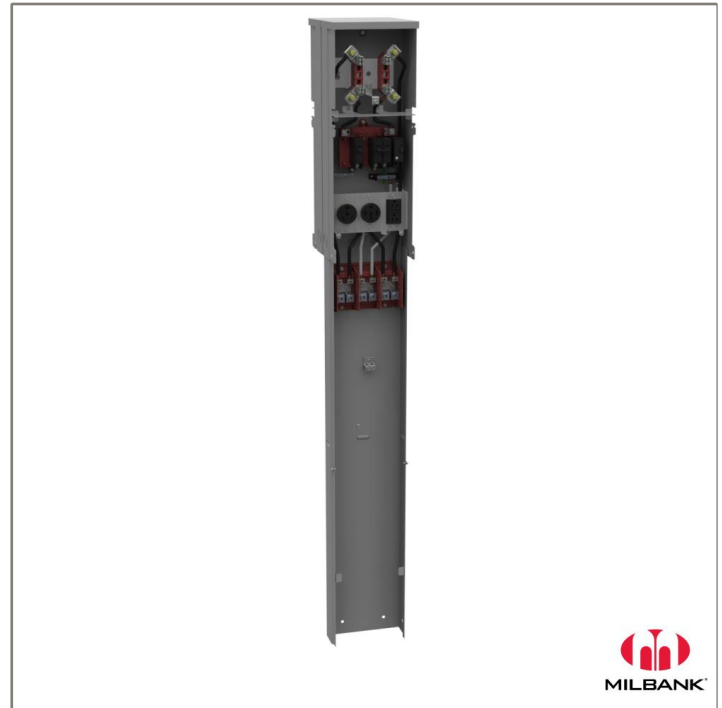

*Utility requirements may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must always be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.*

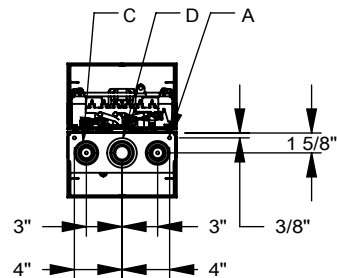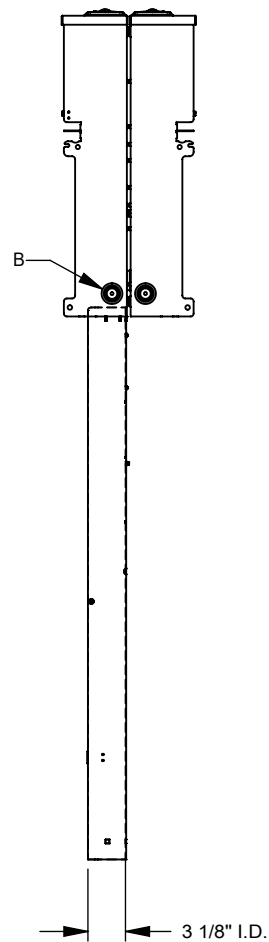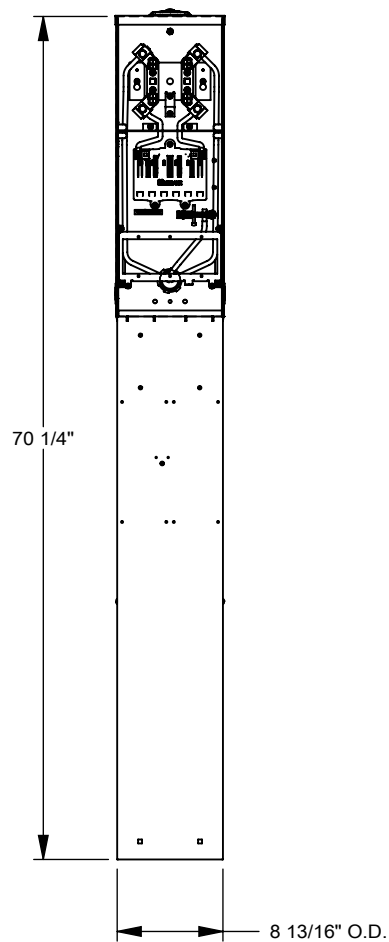

| FEATURE TABLE |     |                            |
|---------------|-----|----------------------------|
| ITEM          | QTY | DESCRIPTION                |
| A             | 2   | ¼ SOLID K.O.               |
| B             | 4   | ½, ¾, 1, 1¼ CONC. K.O.     |
| C             | 2   | ½, ¾, 1, 1¼, 1½ CONC. K.O. |
| D             | 1   | ¾, 1, 1¼, 1½, 2 CONC. K.O. |

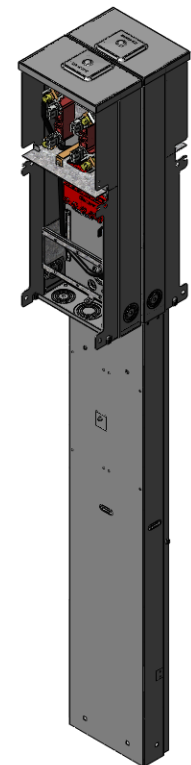

**MILBANK**  
ENERGY AT WORK

Version:

**1**

All dimensions are +/- 1/16".  
Drawing views are not to scale.  
Utility requirements for this equipment may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.