


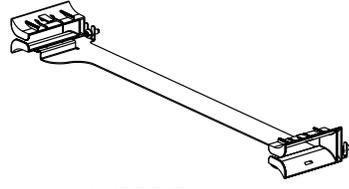

CM263 INSTALLATION INSTRUCTIONS

© Panduit Corp. 2001


Printed in U.S.A.

 <p>WMBZ</p>	<p>Contents: (1) Manager Plate (2) Bend Radius Clip (4) #12-24 Screws</p>
--	--

INSTALLATION:

New installation:

1. Attach patch panel or enclosure on the rack at the desired location using the top two screw locations. Mount the cable manager plate to the patch panel or enclosure at the lower two screw locations.
2. To mount the bend radius clips on each side of the mounting plate, slide the clip onto to the plate tab and snap into the attachment points.
3. Route the cables from the panel to each side of the manager.

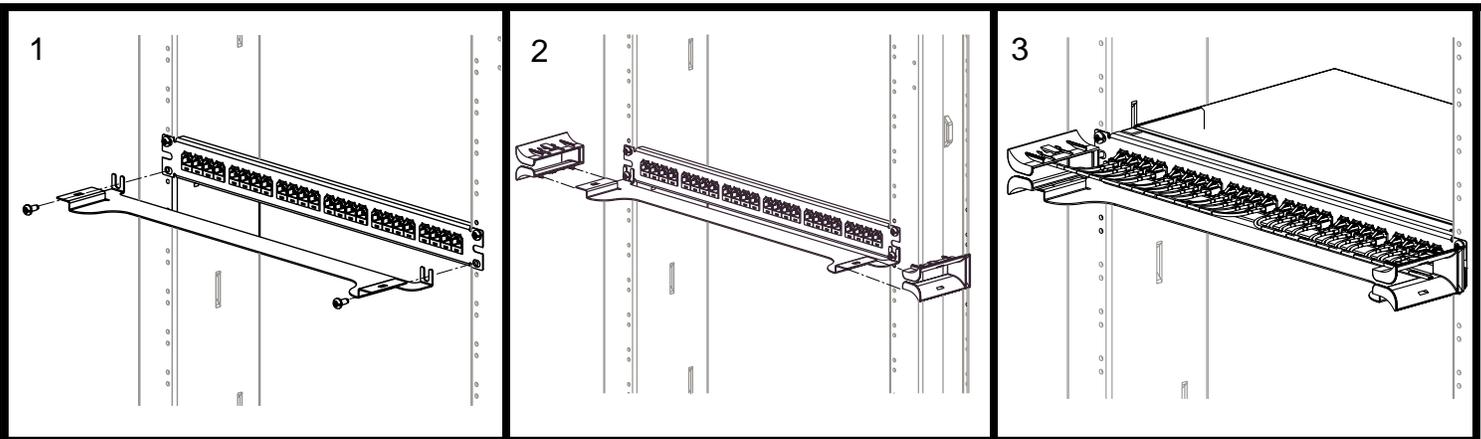

Existing installation:

Loosen two screws from the front of the patch panel or enclosure. Slide the manager plate behind the cables from the panel. Slip the manager plate behind the lower two screws and retighten the screws. Mount the bend radius clips to the attachment points on each side of the mounting plate. Route the cables from the panel to each side of the manager.

WORLDWIDE SUSIDIARIES AND SALES OFFICES



412 Rockwell Court
Burr Ridge, Illinois 60521

Technical Support: 866-405-6654
Fax: 708-444-6993

E-mail: info@panduit.com
Web site: www.panduit.com/ncg